


METER SIZE	BARREL DIAMETER	BARREL COLOR	D&L RING & COVER, OAE	FORD SETTER, OAE	CURB STOP	SERVICE BOX
1½"	24"Ø	WHITE	L-2241 (SEE NOTE 5)	VBHH 76-18-44-66-G or Q	FORD MODEL B11-444 (O.A.E.) 1½" BALL VALVE 1½" FM I.P.T. x 1½" FM I.P.T.	FORD-EA2 40-40-30R (O.A.E.)

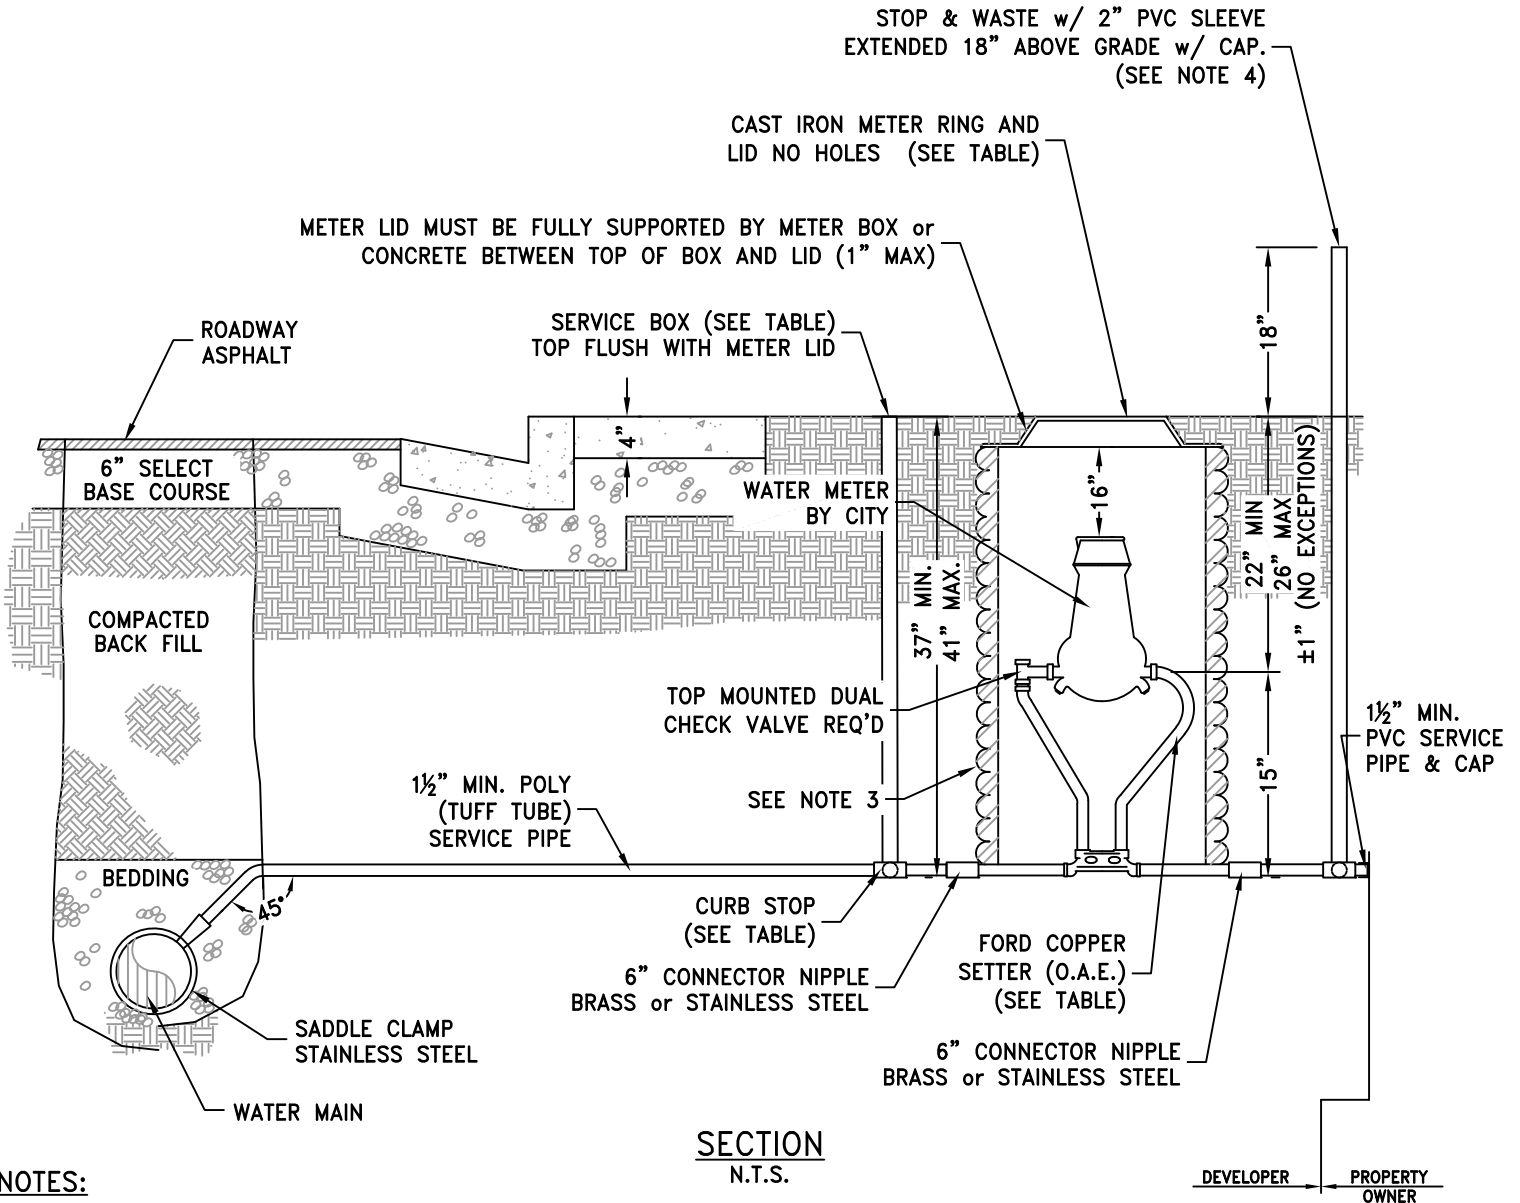

SECTION
N.T.S.

NOTES:

- ON TWIN HOME LOTS THE WATER METERS SHALL BE PLACED 10' FROM EACH SIDE OF LOT LINE.
- ON INDUSTRIAL ZONED ROADS WHERE SIDEWALKS ARE NOT REQUIRED OR INSTALLED THE WATER METERS SHALL BE INSTALLED BEHIND THE CURB & GUTTER.
- METER BOX HDP A.D.S. N-12 (O.A.E.) CORRUGATED POLYETHYLENE PIPE CORRUGATED EXTERIOR/ SMOOTH INTERIOR (SEE TABLE). BOX TO BE A CONTINUOUS PIECE OF PIPE WITH NO EXTENSIONS.
- STOP & WASTE NOT REQUIRED TO BE INSTALLED IF SECONDARY WATER IS AVAILABLE.
- USE D&L B-5024 FOR WATER BARRELS THAT WILL BE INSET IN CONCRETE.



ENOCH CITY
900 E MIDVALLEY RD
Enoch, UT 84721
Tel. (435) 586-1119

1½" WATER METER

SCALE:
N.T.S.
DATE:
DEC. 2022

DETAIL No.:

W5.2B

SHEET:
2 of 2